


# FIRE RETARDANT TREATED WOOD LABELS REQUIRE THE FOLLOWING INFORMATION

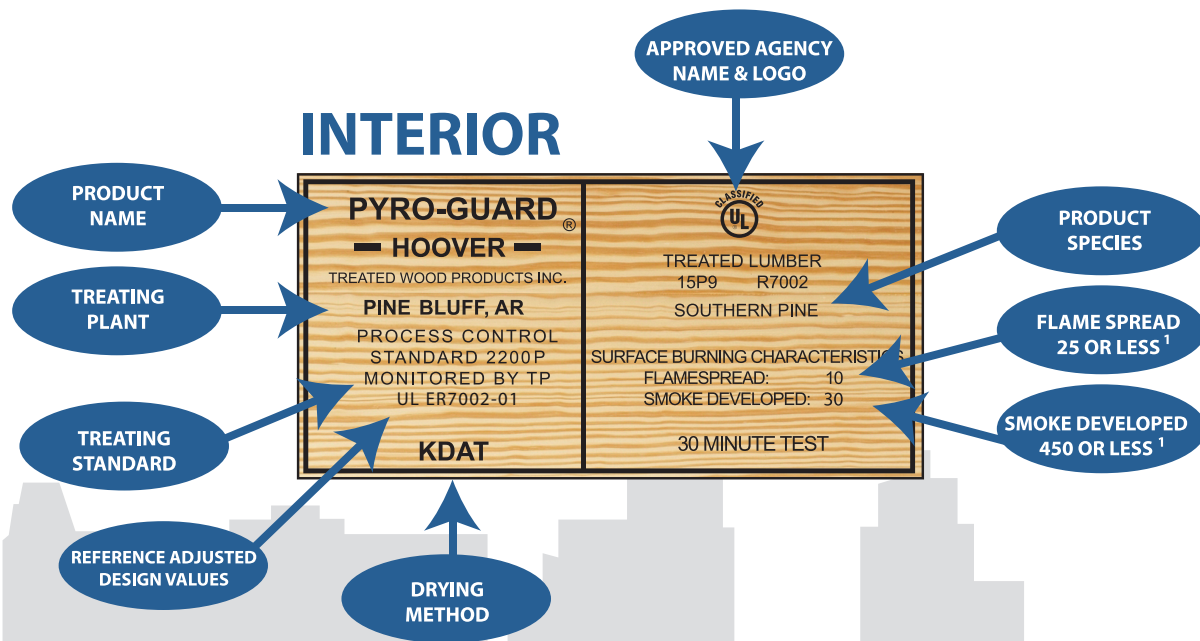

Product coloration is not a substitute for a building code approved, third-party inspection agency label.

For additional copies of this card, contact our Technical Department  
TECWOOD@FRTW.COM • 1.800.TEC.WOOD

1. Actual flame spread index and smoke developed index shall be noted.

## IBC/IRC 2006, 2009, 2012

### 2303.2.4 Labeling.

Fire-retardant-treated lumber and wood structural panels shall be labeled.  
The label shall contain the following items:

1. The identification mark of an approved agency in accordance with [Section 1703.5](#).
2. Identification of the treating manufacturer.
3. The name of the fire-retardant treatment.
4. The species of wood treated.
5. Flame spread and smoke-developed index.
6. Method of drying after treatment.
7. Conformance with appropriate standards in accordance with Sections [2303.2.2](#) through [2303.2.5](#).
8. For fire-retardant-treated wood exposed to weather, damp or wet locations, include the words "No increase in the listed classification when subjected to the Standard Rain Test" (ASTM D 2898).



## REPRINTED FROM 2006, 2009, 2012 INTERNATIONAL BUILDING CODE

**2303.2 Fire-retardant-treated wood.** Fire-retardant-treated wood is any wood product which, when impregnated with chemicals by a pressure process or other means during manufacture, shall have, when tested in accordance with ASTM E 84 or UL 723, a listed flame spread index of 25 or less and show no evidence of significant progressive combustion when the test is continued for an additional 20-minute period. Additionally, the flame front shall not progress more than 10 1/2 feet (3200 mm) beyond the centerline of the burners at any time during the test.

**2303.2.1 Pressure process.** For wood products impregnated with chemicals by a pressure process, the process shall be performed in closed vessels under pressures not less than 50 pounds per square inch gauge (psig) (345 kPa). [2009/2012]

**2303.2.2 Other means during manufacture.** For wood products produced by other means during manufacture, the treatment shall be an integral part of the manufacturing process of the wood product. The treatment shall provide permanent protection to all surfaces of the wood product. [2009/2012]

**2303.2.3 Testing.** For wood products produced by other means during manufacture, other than a pressure process, all sides of the wood product shall be tested in accordance with and produce the results required in [Section 2303.2](#). Wood structural panels shall be permitted to test only the front and back faces. [2009/2012]

**2303.2.5 Strength adjustments.** Design values for untreated lumber and wood structural panels, as specified in [Section 2303.1](#), shall be adjusted for fire-retardant-treated wood. Adjustments to design values shall be based on an approved method of investigation that takes into consideration the effects of the anticipated temperature and humidity to which the fire-retardant-treated wood will be subjected, the type of treatment and redrying procedures.

**2303.2.5.1 Wood structural panels.** The effect of treatment and the method of redrying after treatment, and exposure to high temperatures and high humidities on the flexure properties of fire-retardant-treated softwood plywood shall be determined in accordance with ASTM D 5516. The test data developed by ASTM D 5516 shall be used to develop adjustment factors, maximum loads and spans, or both, for untreated plywood design values in accordance with ASTM D 6305. Each manufacturer shall publish the allowable maximum loads and spans for service as floor and roof sheathing for its treatment.

**2303.2.5.2 Lumber.** For each species of wood that is treated, the effects of the treatment, the method of redrying after treatment and exposure to high temperatures and high humidities on the allowable design properties of fire-retardant-treated lumber shall be determined in accordance with ASTM D 5664. The test data developed by ASTM D 5664 shall be used to develop modification factors for use at or near room temperature and at elevated temperatures and humidity in accordance with ASTM D 6841. Each manufacturer shall publish the modification factors for service at temperatures of not less than 80°F (27°C) and for roof framing. The roof framing modification factors shall take into consideration the climatological location.

**2303.2.6 Exposure to weather, damp or wet locations.** Where fire-retardant-treated wood is exposed to weather, or damp or wet locations, it shall be identified as “Exterior” to indicate there is no increase in the listed flame spread index as defined in [Section 2303.2](#) when subjected to ASTM D 2898.

**2303.2.7 Interior applications.** Interior fire-retardant treated wood shall have moisture content of not over 28 percent when tested in accordance with ASTM D 3201 procedures at 92-percent relative humidity. Interior fire retardant-treated wood shall be tested in accordance with [Section 2303.2.5.1](#) or [2303.2.5.2](#). Interior fire-retardant-treated wood designated as Type A shall be tested in accordance with the provisions of this section.

**2303.2.8 Moisture content.** Fire-retardant-treated wood shall be dried to a moisture content of 19 percent or less for lumber and 15 percent or less for wood structural panels before use. For wood kiln dried after treatment (KDAT), the kiln temperatures shall not exceed those used in kiln drying the lumber and plywood submitted for the tests described in [Section 2303.2.5.1](#) for plywood and [2303.2.5.2](#) for lumber.